


Notes:

The insert hole diameter in the existing pipe shall be a minimum 2" larger than the outside diameter of the proposed pipe. The reinforcing steel in the existing pipe shall be bent into the concrete collar. All cost of the direct tap shall be included in the price bid for storm sewer items. Flow in the existing pipe shall be maintained at all times.

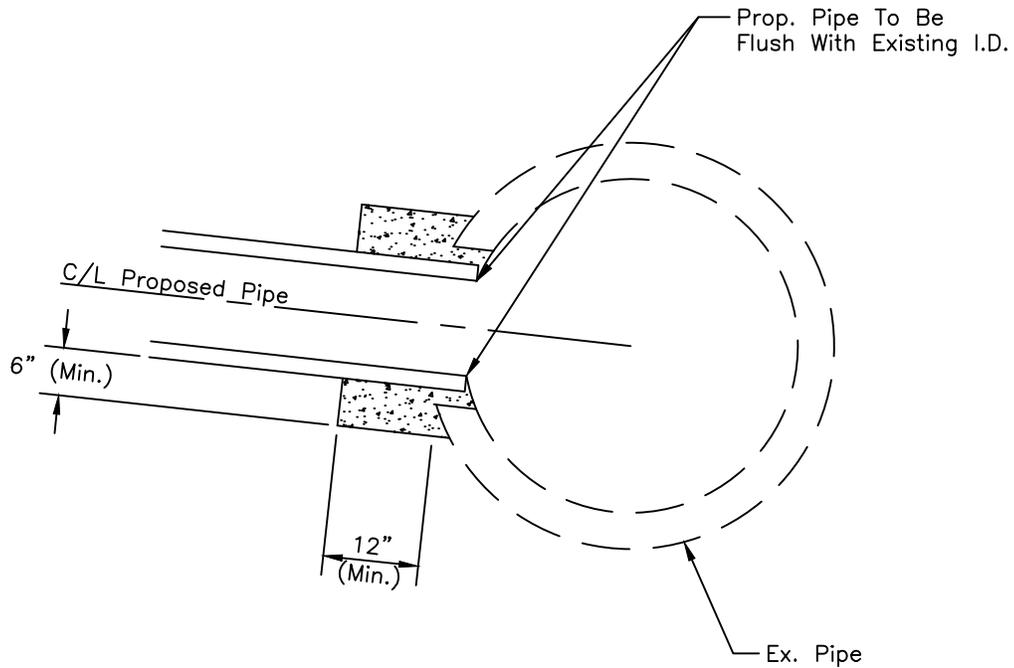

S:\Public Service - Engineering\Hilliard Standards\Drawings\ACAD\Direct Tap.dwg, 9/30/2015 7:12:42 AM

APPROVED	DIRECT TAP DETAIL	CITY OF HILLIARD, OHIO	
CITY ENGINEER _____ DATE _____		STANDARD CONSTRUCTION DRAWING	
SCALE: 1/2" = 1'		1/1	DT-1