


Notes:

1. The contractor shall place trench dams along the trench at the locations indicated on the plans.
2. For 6" sanitary sewer services, one (1) trench dam is to be placed between the main sewer and the building at a maximum distance of ten (10) feet from the main sewer.
3. Cost for trench dams to be included in the price bid for sewer.

D (in)	Wn (in)	L (ft)
6	30	10
8	30	10
10	30	10
12	32	10
15	36	10
18	40	11
21	44	11
24	48	11
27	52	11
30	56	12
36	64	12
42	72	13
48	80	13

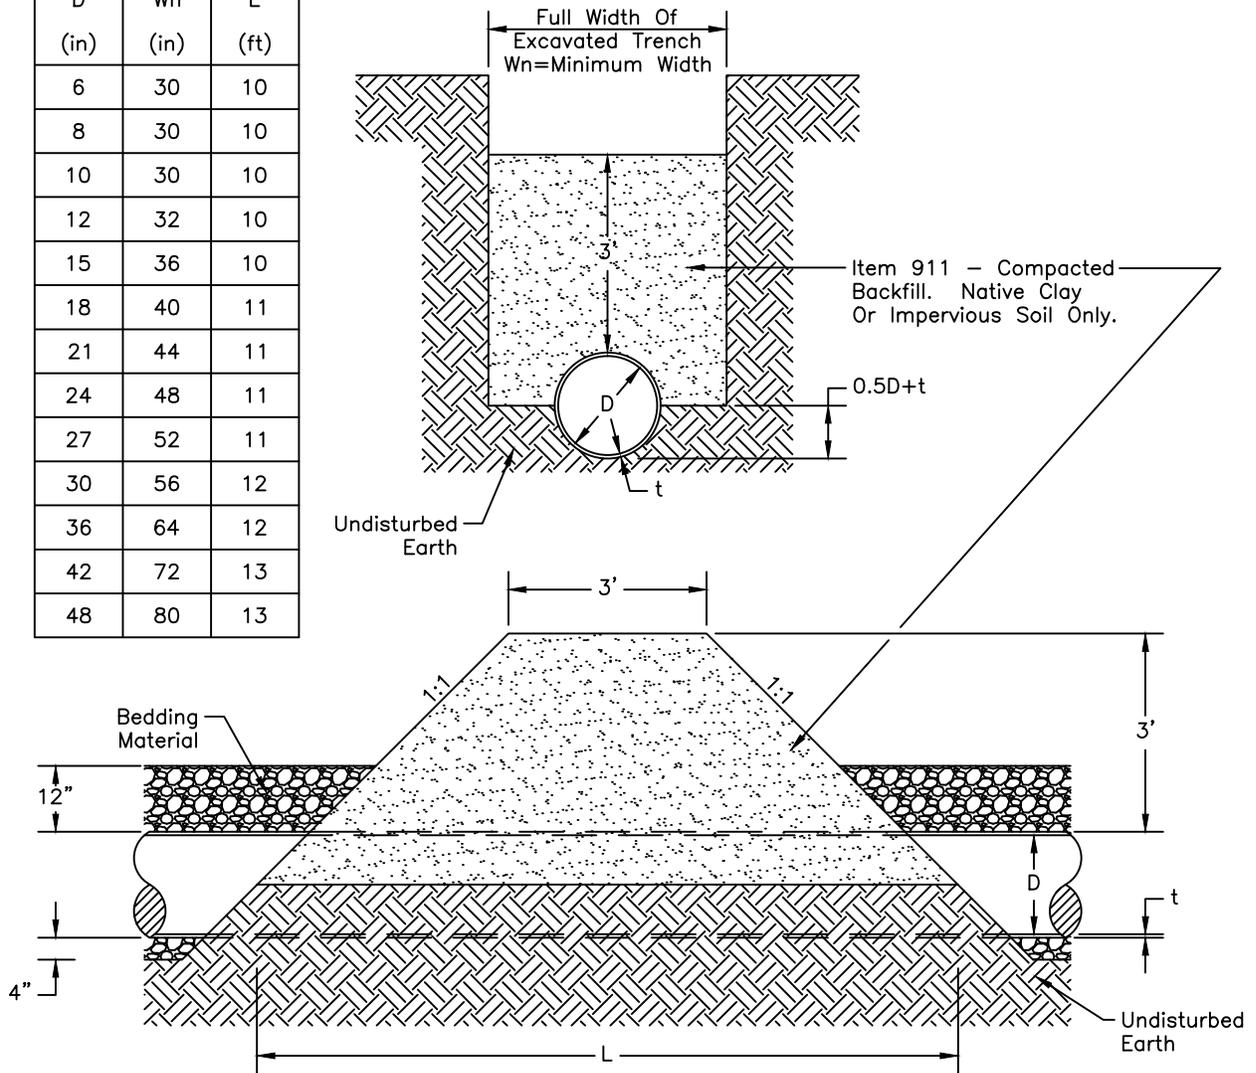

APPROVED

CITY ENGINEER

DATE

SCALE: NTS

TRENCH DAM DETAIL

CITY OF
HILLIARD, OHIO

STANDARD
CONSTRUCTION DRAWING

1/1

TD-1